


TIMBER WALKWAY TO BE PROVIDED FROM GABLE TO GABLE RUNNING ADJACENT TO THE ROOF SPACE HATCH.A MIN WIDTH OF 900MM IS TO BE ACHIEVED. WALKWAYS WILL BE REQUIRED TO BE RAISED ABOVE INSULATION, PIPES AND DUCT RUNS. SUPPORTS SHOULD RUN PERPENDICULAR TO THE MAIN CEILING JOISTS / TRUSSES AT A MIN OF 450MM CENTRES.

GUARDING  
MINIMUM HEIGHT OF GUARDING: 1100MM  
MINIMUM HORIZONTAL FORCE PER METRE RUN: 0.74 KN/M

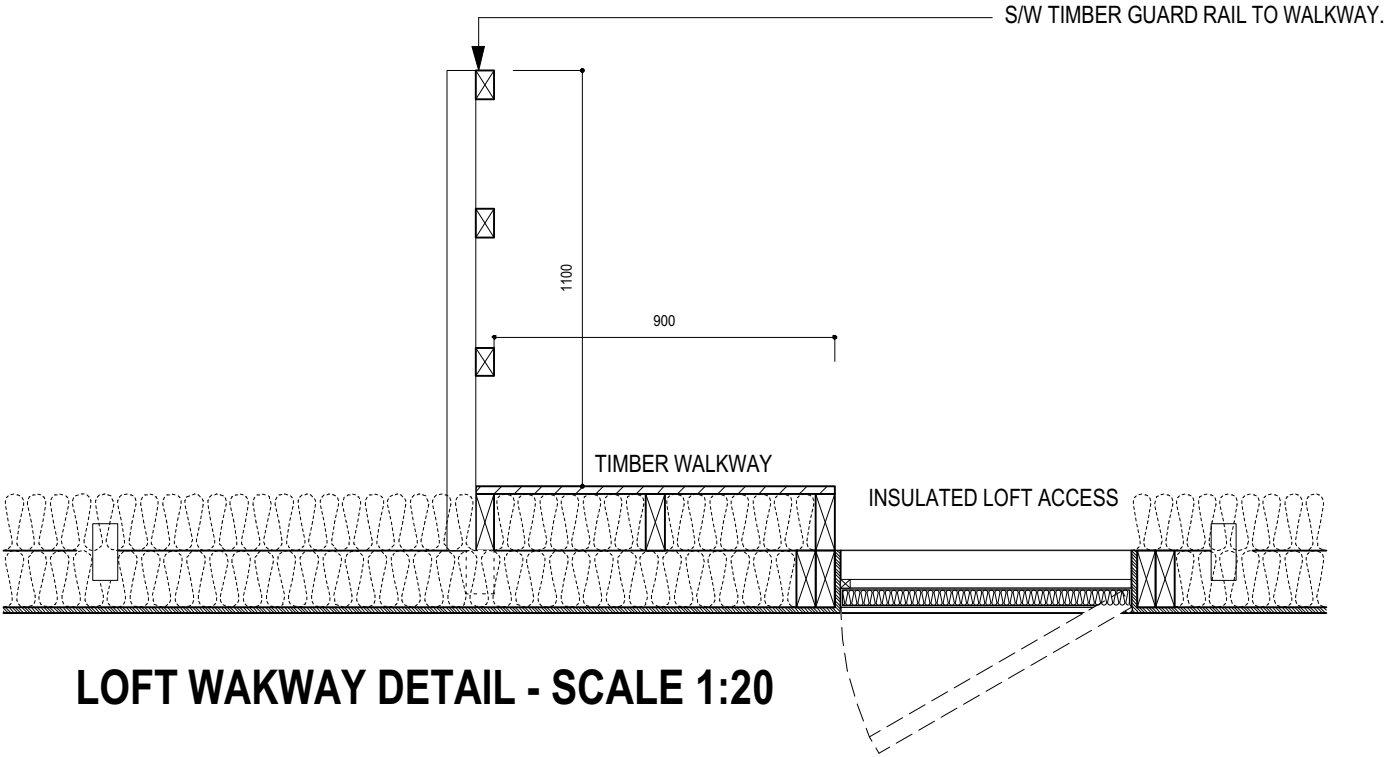

**TENDER**