


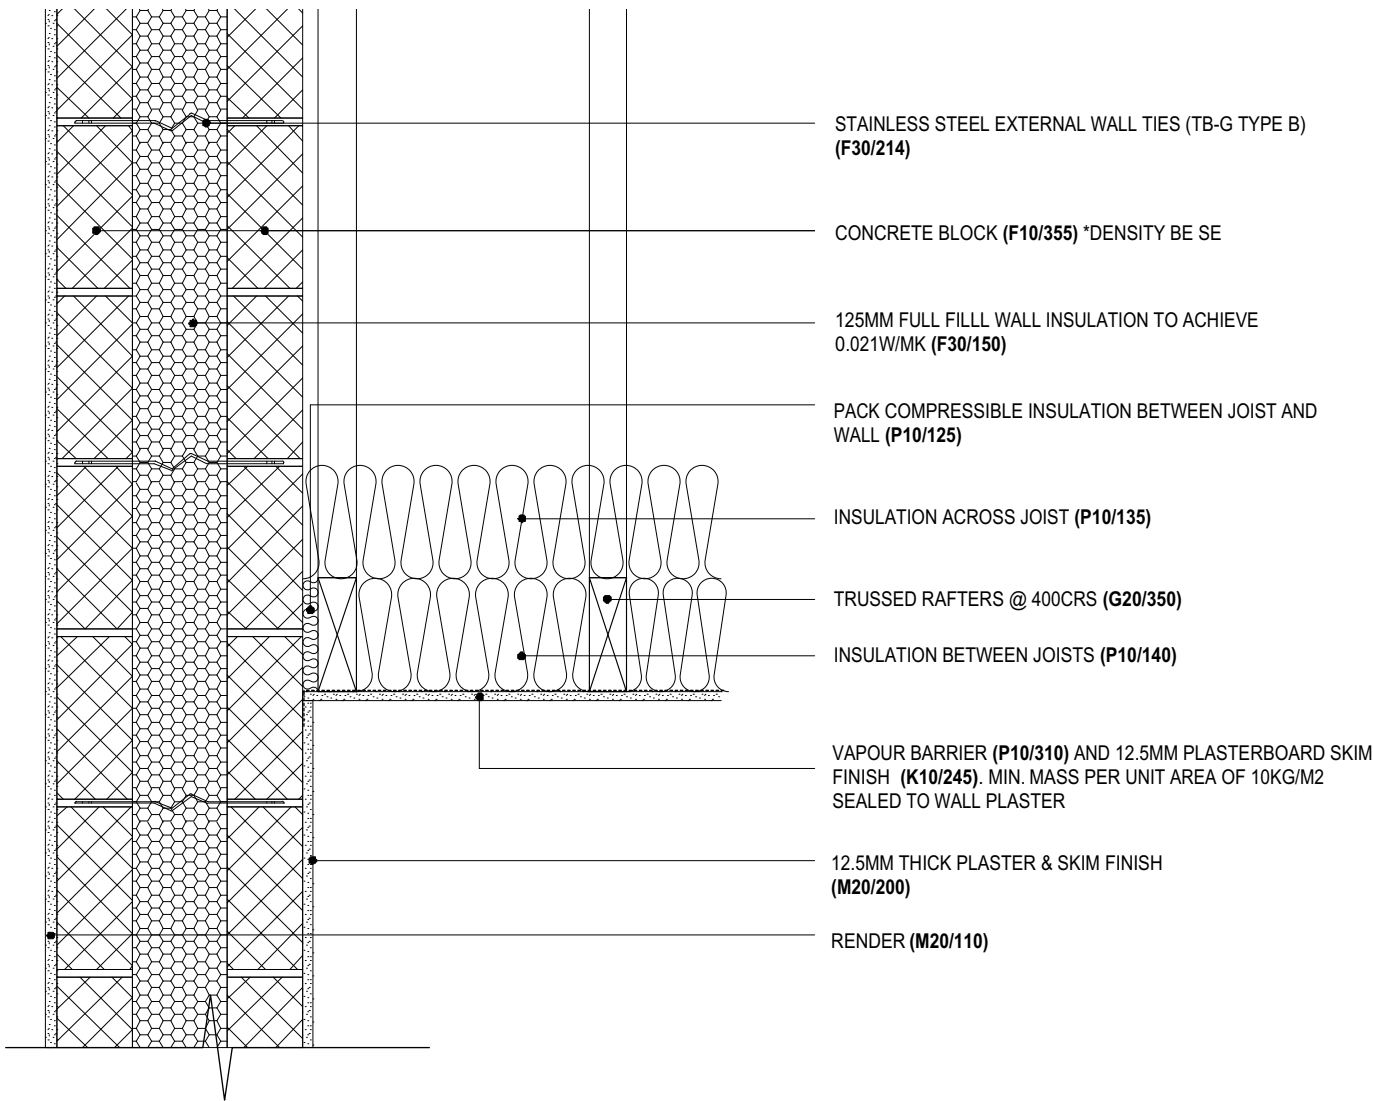

EXTERNAL WALL CONSTRUCTION TO PROVIDE A MINIMUM U VALUE OF 0.13
ROOF CONSTRUCTION TO PROVIDE A MINIMUM U VALUE OF 0.13

REFER TO ACCREDITED DETAIL MCI-RG-01

- NOTE:**
- ENSURE ALL CAVITIES ARE KEPT FREE OF DEBRIS DURING CONSTRUCTION
 - PACK COMPRESSIBLE INSULATION BETWEEN TRUSS/JOIST AND GABLE WALL
 - ENSURE THAT THE FULL DEPTH OF INSULATION OVER AND BETWEEN THE JOISTS EXTENDS FULLY TO THE GABLE WALL
 - ENSURE THE WALL INSULATION IS SECURED FIRMLY AGAINST THE INNER LEAF OF THE CAVITY
 - FIX CEILING FIRST AND SEAL ALL GAPS BETWEEN THE CEILING AND MASONRY WALL WITH EITHER PLASTER, ADHESIVE OR FLEXIBLE SEALANT
 - SEAL ALL PENETRATIONS THROUGH THE AIR BARRIER (PLASTERCOAT) WITH FLEXIBLE SEALANT

SOUND REQUIREMENTS AS PER BLDG REGS TECHNICAL BOOKLET G (TB-G):

SOUND TESTING (AS TBG SECTION 1 & APPENDIX B):
CONTRACTOR TO CARRY OUT SOUND TESTING BETWEEN DWELLINGS AND ACHIEVE CURRENT REQUIRED PERFORMANCE STANDARDS IN ACCORDANCE WITH PART G NI BUILDING REGULATIONS 2012.
CONTRACTOR WILL BE RESPONSIBLE FOR THE DESIGN / TESTING TO CURRENT REGULATIONS AND BE RESPONSIBLE FOR ANY ADDITIONAL / REMEDIAL WORK REQUIRED.
ADDITIONAL TESTING TO BE UNDERTAKEN, AS REQUIRED, UNTIL SUCH TIMES AS CURRENT REGULATIONS ARE FULLY COMPLIED WITH.

TENDER